

# WASTEWATER UTILITY REPORT

## April 2023

**Wastewater Connections**


0.28% (12) of 4222 improved parcels are remaining to connect. Those not yet connected are five (5) residential properties and seven (7) non-residential properties.

New units constructed after October 2019 are not included in the parcel counts in the chart below. Wastewater connection for new construction is mandatory before a Certificate of Occupancy is issued.

AREA	Total Parcels	Parcels Connected	% CONNECTED
NPK	1183	1182	99.92%
MPK	691	691	100.00%
SPK/WK	815	812	99.63%
UMK	559	554	99.11%
LMK	974	971	99.69%
<b>TOTALS</b>	<b>4222</b>	<b>4210</b>	<b>99.72%</b>


**Monthly Wastewater Flows**

The Transfer Pump Station pumped 23,454 million gallons in April 2023.

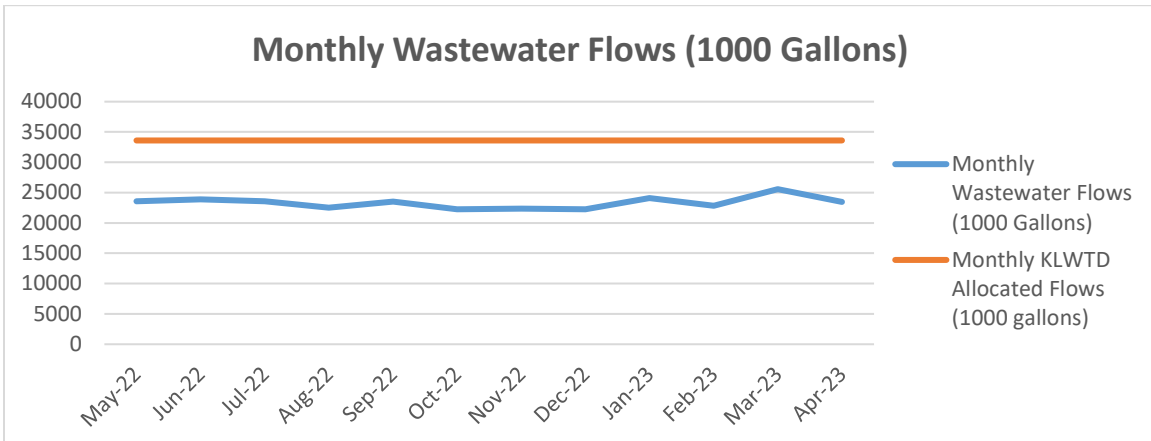

**Salinity**

Salinity level was within compliance range per the interlocal agreement with KLWTD.

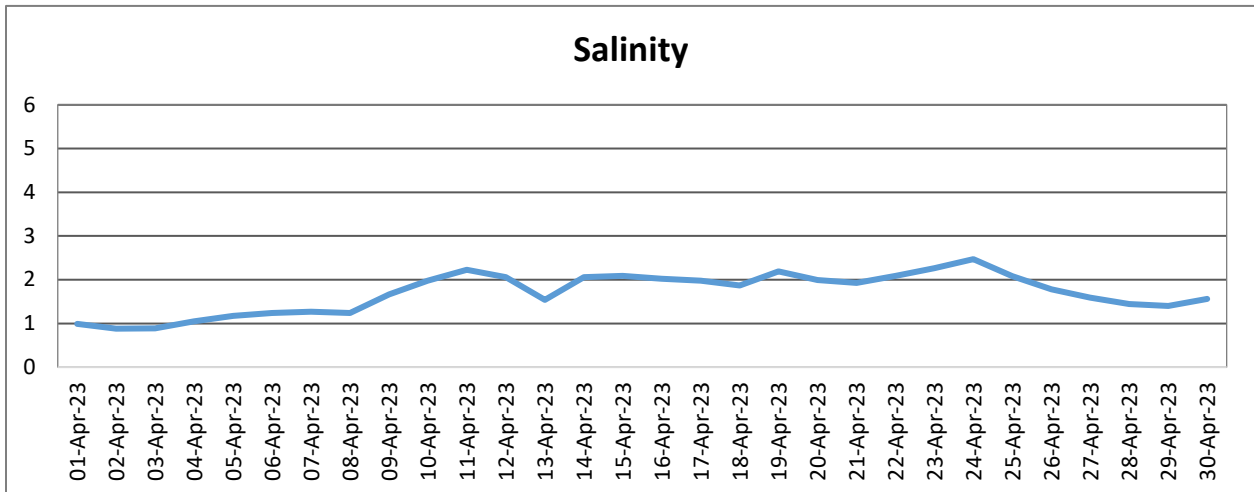

**Package Plants not yet connected**

63 Plants from Original List  
 5 Facilities Closed  
 58 Total Package Plants

56 connected

1 In Progress

1 No progress

2 not connected

as of 5/12/2023