



## DECEMBER 2020 KENTWOOD FIRE DEPARTMENT REPORT

RESPONSE SUMMARY				
NFIRS INCIDENT TYPE SERIES	DEC 2020	2020 YTD	2019 YTD	YTD CHANGE
Fire	12	145	101	43.56%
Explosion, Excessive Heat	1	3	6	
EMS	285	3050	3180	-4.09%
Hazardous Condition, Standby	14	173	193	-10.36%
Service	21	200	284	-29.58%
Good Intent	46	533	588	-9.35%
False	18	329	350	-6.00%
Other	0	2	3	
<b>TOTAL</b>	<b>397</b>	<b>4435</b>	4705	-5.74%

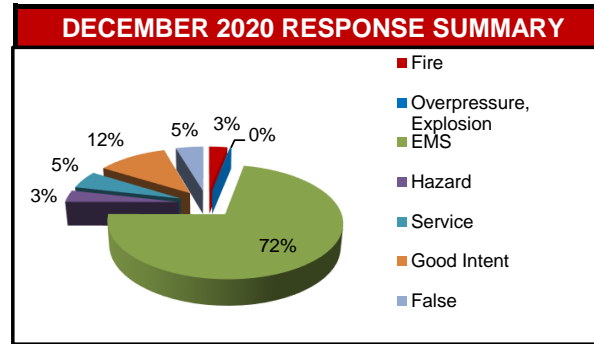


DECEMBER FIRES	
Building	Plover, Nature Trail, Ticonderoga
Mobile Home	
Cooking	Center Green Meadow, N. Quail Crest, Pine Meadow (2)
Chimney	29th
Vehicle	44th (2), Drummond
Outside storage	44th

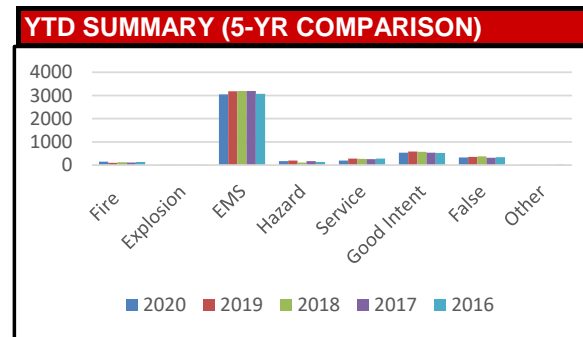

POC RESPONSE SUMMARY				
	DEC 2020	2020 YTD	2019 YTD	YTD CHANGE
Toned Out Calls	9	147	192	-23.44%

Since mid-March no POC have responded, but would have been called.

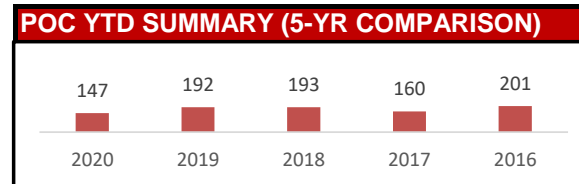



DECEMBER REASON FOR EMS CALL (excluding Unknown, NA)							
Abdominal Pain	10	Chest Pain	31	Headache	2	Psych. Prob/Suicide Attempt	10
Allergies		Choking		Heart Problems	3	Sick	10
Animal Bite		CO Poisoning/Hazmat	1	Heat/Cold Exposure		Stab/Gunshot	1
Assault	7	Convulsions/Seizure	10	Hemorrhage/Laceration	4	Stroke/CVA	7
Back Pain	3	Diabetic Problem	6	Industrial Accident		Traffic Accident	24
Breathing Problem	70	Electrocution/Lightning		Medical Alarm		Traumatic Injury	3
Burns		Eye Problem	1	Overdose/Ingestion/Poisoning	4	Unconscious/Fainting	19
Cardiac Arrest		Falls	27	Pregnancy/Childbirth	1	Well Person Check	2

NARCAN (NALOXONE) USE				
	DEC 2020	2020 YTD	2019 YTD	YTD CHANGE
Times Administered	3	20	16	25.00%

DECEMBER AID BY DEPARTMENT (Multiple departments DECEMBER respond to single incident)		
DEPARTMENT	Given	Received
Airport	1	
Byron Twp.		
Caledonia		
Cascade	1	
Cutlerville	1	1
Dutton/Gaines	1	2
Grand Rapids		
Grand Rapids Twp.		
Grandville		
Wyoming	5	

CASUALTIES			
	DEC 2020	2020 YTD	2019 YTD
Fire Service Injuries	0	1	5
Civilian Injuries	0	3	3
Fire Service Deaths	0	0	0
Civilian Deaths	0	1	3

FIRE PREVENTION BUREAU				
ACTIVITIES	DEC 2020	2020 YTD	2019 YTD	YTD CHANGE
Construction Plan Review	27	233	336	-30.65%
New Construction/Addition	4	21	37	
Remodel	8	59	113	
Sprinkler	7	51	75	
Site Plan	3	52	56	
Fire Alarm	5	43	55	
Demolition	0	7		
Annual Business Inspections	18	273	745	-63.36%
Annual Initial	0	112	493	
Reinspections	0	46	252	
Self Inspections	18	115		
Pre-Occupancy Inspections	0	6	9	
Certificate of Occupancy Insp.	3	47	46	
Not Ready	0	0	2	
Walk Through	3	17	49	
Tent Inspections	0	0	0	
Protection/Detection Systems	2	100	118	
Complaint Investigation	0	9	5	
Vacant/Closed Businesses	13	75	108	
Investigations	3	22	18	22.22%
Smoke Detector Installations	16	380	302	25.83%
CO Alarm Installations	3	35	94	-62.77%

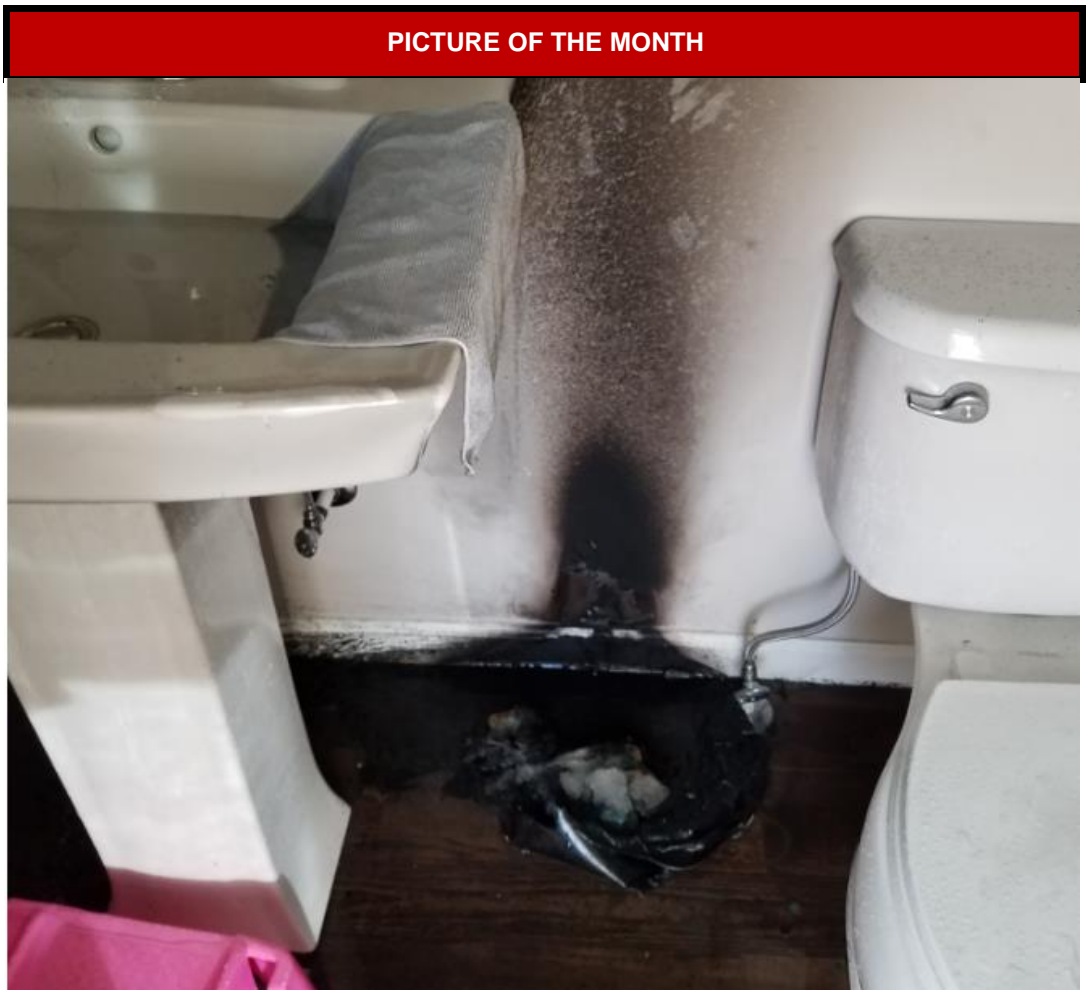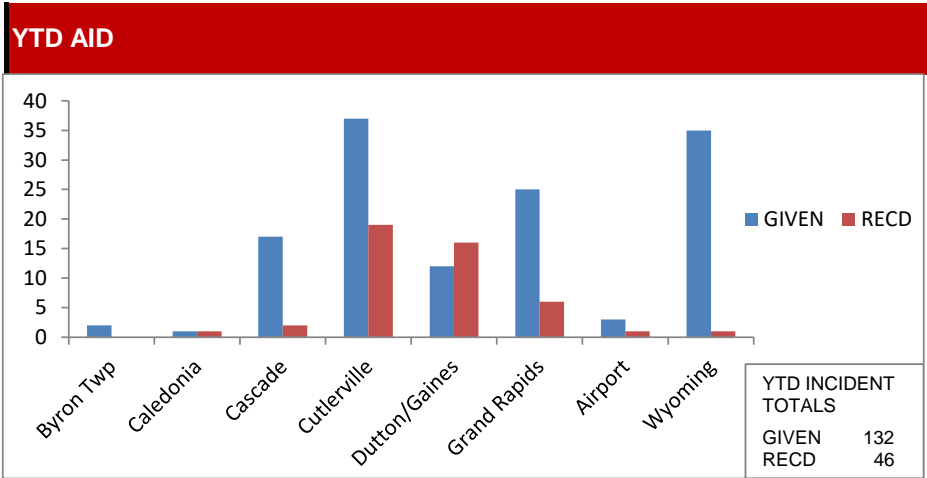

Plover Dr., December 1  
Toilet water line extinguished trash fire