

Why are you getting this report?

The U.S. Environmental Protection Agency and the State of Michigan require all community water system suppliers to put the annual water quality report into the hands of the customer. Rule 63 FR 44511, effective August 19, 1998 requires that all water suppliers shall mail or otherwise directly deliver one copy of their consumer confidence report to each billing customer. Systems serving 10,000 or more are not eligible for a mailing waiver.

Esta publicacion contiene informacion importante sobre el agua que usted bebe diariamente. Si no lo entiende, busque a alguien que se lo traduzca o le explique su contenido. Para mas informacion, llame al (616) 530-7389 o visite pagina electronica. www.epa.gov/espanol/



City of Kentwood
4900 Breton Avenue, SE
Kentwood, MI 49518

City of Kentwood 2013

Annual Water Quality Report

This report is a summary of the water quality provided to you from the City of Kentwood. Included are details with regard to what the water contains, how it compares to regulatory standards and other useful information. Not listed are the hundreds of other possible contaminants which were tested for and not detected.



City of Kentwood Water Pumping Station



Kentwood source for drinking water is Lake Michigan.

Rain, groundwater, rivers and streams feed into Lake Michigan, dissolving naturally occurring minerals and sometimes picking up substances resulting from the presence of animals or from human activity. Some of the substances that can make their way into Lake Michigan are: viruses and bacteria from animals, agricultural and human activities. Salts, metals, pesticides and herbicides, as well as by-products of industrial processes. In order to ensure that tap water is safe to drink, EPA prescribes regulations, called Maximum Contaminant Levels (MCLs) that limit the amount of certain contaminants in your drinking water. You can participate in public hearings related to the protection of our source water by contacting the Michigan Department of Environmental Quality (MDEQ) on the web at www.deq.state.mi.us.



Pine Wood Park Splash Pad

We are pleased to report that your drinking water meets and often exceeds all state and federal guidelines for safe drinking water.

The staff at the Kentwood Water Department perform many functions necessary to keep the water quality at the high standards we have come to expect. One of the tasks performed twice a week is collecting water samples from key location within the city and having them tested to ensure the water provided continues to be safe and healthy. In addition, there are over 10,000 tests performed annually at the water treatment plant. For more information about contaminants and potential health effects call the EPA's Safe Drinking Water Hotline: (800) 426-4791.

For technical questions about this report or with any other water quality concerns, Call the water department Chief Operator Terry Steenhagen, at (616) 554-0767.

Copies of this report are available at Kentwood City Hall, the Department of Public Works, the Richard L. Root Public Library and the Kentwood Parks and Recreation Department.

Kentwood City Commission meetings are held at the City Hall located at 4900 Breton Ave. Meetings are held the 1st and 3rd Tuesday of each month at 7:00 pm.


If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. We are responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested.

Information on lead in drinking water, testing methods and steps you can take to minimize exposure is available from the Safe Drinking hotline at (800) 426-4791 or the EPA website located at <http://water.epa.gov/drink/info/lead/index.cfm>.

Our water supply has a moderately high susceptibility to contaminants. For a copy of the most current Source Water Assessment of the water system please contact the City of Wyoming Water Treatment Plant at 616-399-6511.

Testing is performed to detect the presence of **Cryptosporidium and Giardia**, which are protozoan parasites that occur in natural surface waters such as lakes, rivers and streams. The Wyoming water treatment process provides multiple barriers, including clarification, filtration and disinfection to lower the risk of these contaminants in the public water supply. Monitoring of treated water samples yielded a 100% removal rate, highlighting the effectiveness of the treatment system in microscopic particle removal.

The men and women at the City of Kentwood are constantly studying and planning for needed system improvements. Development and review of a water system master plan is one of our priorities. Staff from each of the different departments work together to orchestrate distribution system repairs and upgrades that are necessary in order to continue providing the reliable and safe drinking water we take for granted. We continue to plan, design and operate the current and constantly changing water distribution system. We are committed to providing a reliable supply of high-quality, safe drinking water now and into the future.

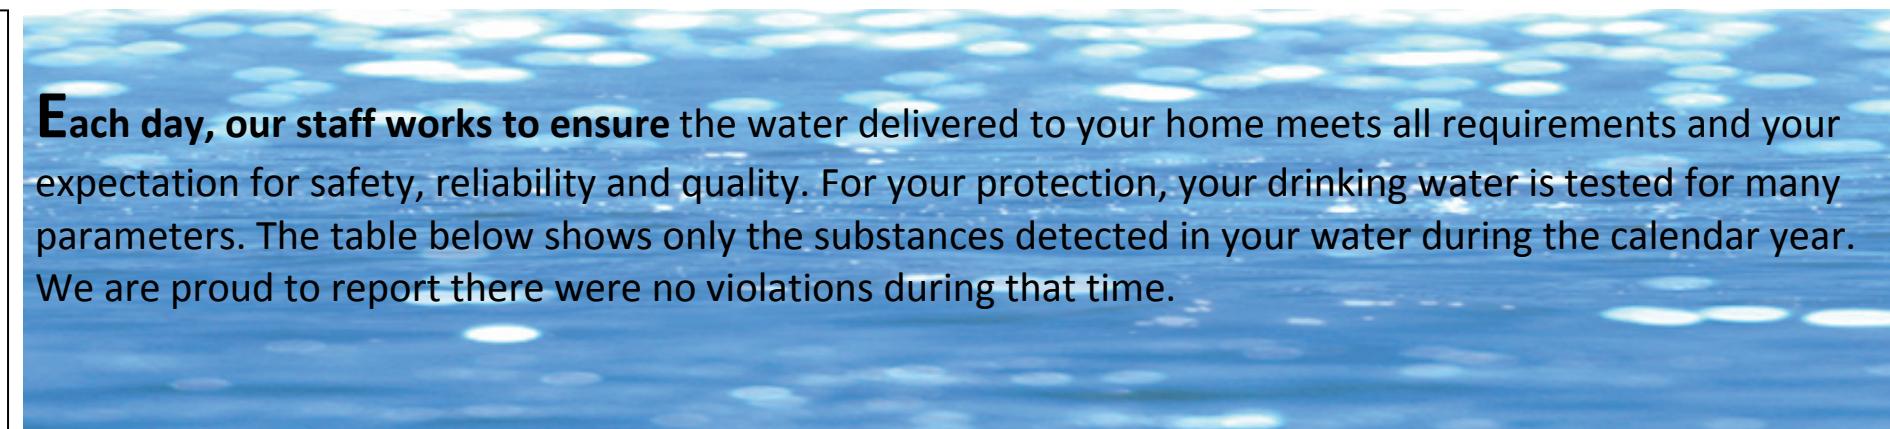

City of Kentwood's Water Quality Report 2013

REGULATED MONITORING AT THE WYOMING WATER TREATMENT PLANT

SUBSTANCE	UNITS	LEVEL FOUND	MCL	MCLG	SAMPLES EXCEEDING MCL	POSSIBLE SOURCES
Fluoride	PPM	0.88	4.0	4.0	0	Additive which promotes strong teeth
Turbidity*	NTU	0.28	TT = 0.5 NTU	NA	0	Soil runoff and natural sediment

*100% of Turbidity sample levels were found to be below .3 NTU.

REGULATED MONITORING IN THE KENTWOOD DISTRIBUTION SYSTEM

SUBSTANCE	UNITS	RANGE DETECTED	Highest Running annual Average	MCL	MCLG	SAMPLES EXCEEDING MCL	POSSIBLE SOURCES
Chlorine Residual	PPM	0.11 – 2.1	0.8	4.0	MRDL=4	0	Used to disinfect drinking water
Haloacetic Acids	PPB	11 – 30	23	60	NA	0	Formed when chlorine is added to water with naturally occurring organic material
Trihalomethanes	PPB	24– 39	37	80	NA	0	

REGULATED MONITORING AT CUSTOMER'S TAP

SUBSTANCE	UNITS	90 th PERCENTILE*	AL	MCLG	SAMPLES EXCEEDING AL	POSSIBLE SOURCES
Copper	PPM	111	1300	1300	0	Corrosion of household plumbing system, erosion of natural deposits, micronutrients
Lead	PPB	4	15	0	0	

*Compliance is determined using the 90th percentile, where nine out of ten samples must be below the Action Level.

UNREGULATED MONITORING

SUBSTANCE	UNITS		LEVEL FOUND	SOURCE
Chloride	PPM		30	Naturally present in the environment
Hardness	PPM		165	Naturally present due to dissolved calcium and magnesium salt
pH	pH units		7.5	pH is an important measurement of the acidity or alkalinity of the water
Sodium	PPM		15	Naturally present in the environment

Definition Key

AL – Action Level: The concentration of a contaminant which, if exceeded, triggers a treatment or other requirement, which a water system must follow.

MCL – Maximum Contamination Level: This is the highest level of a substance that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

MCLG – Maximum Contamination Level Goal: The level of a substance in drinking water below which there is no known or expected health risk; MCLGs allow for a margin of safety.

MRDL – Maximum Residual Disinfectant Level: The highest level of a disinfectant allowed in a drinking water. There is convincing evidence that the addition of disinfectant is necessary for control of microbial contaminants.

MRDLG - Maximum Residual Disinfectant Level Goal: The level of drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contamination.

NA – Not applicable.

ND – Not detected.

NTU – Nephelometric Turbidity Unit: Measurements of minute suspended particles; used to judge water clarity.

PPB – Parts per Billion: Parts per billion or micrograms per liter (ug/l).

PPM – Parts per Million: Parts per million or milligrams per liter (mg/l).

TT – Treatment Technique: A required process, intended to reduce the level of a contaminant in drinking water.