


RESIDENTIAL STAIRWAY REQUIREMENTS

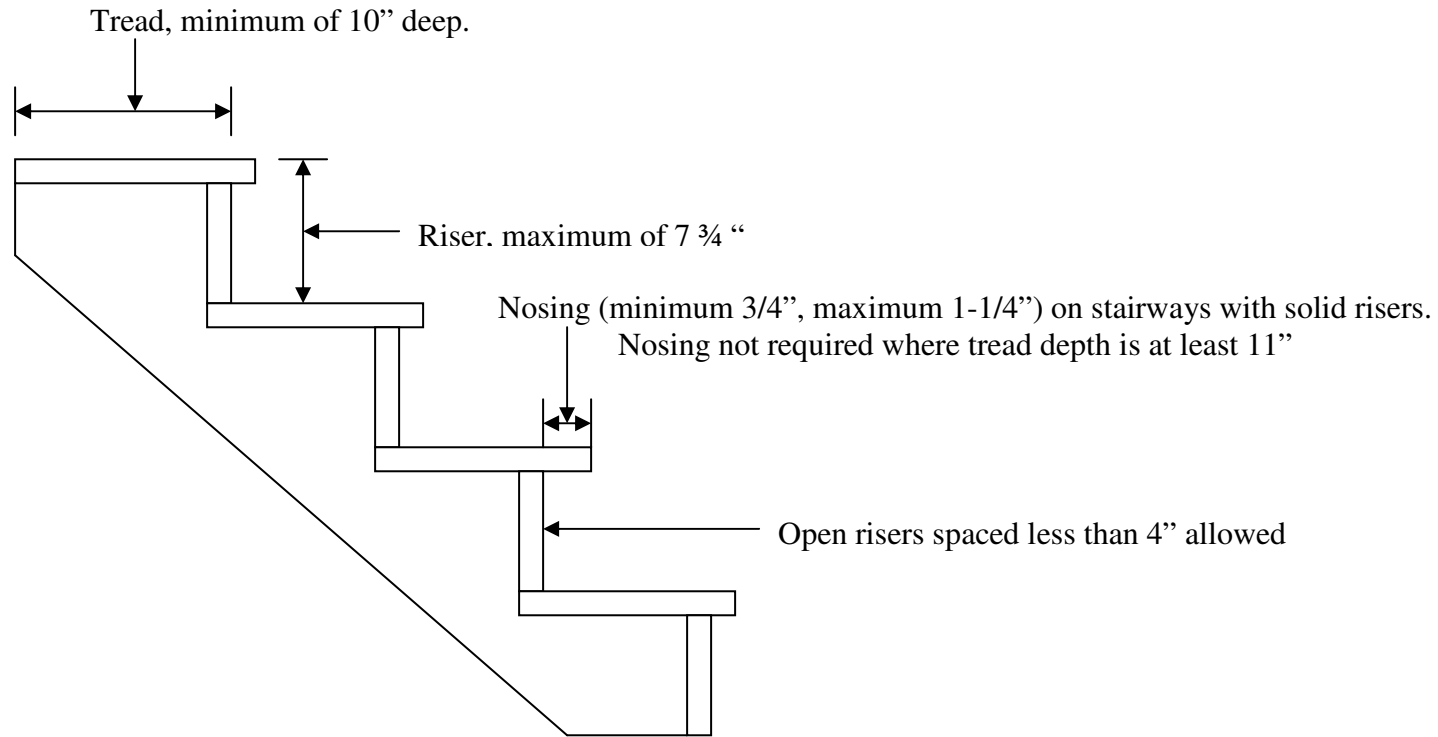

Notes

1. Minimum stairway width of 36" (excluding handrail projections).
2. Minimum 36" wide landing required at top and bottom of stairway.
3. Not more than 12' allowed between landings.
4. Handrail required if 4 or more risers or more than 30" total rise.
5. Handrails required on both sides for open stairs.
6. Handrail height between 34" & 38" above leading edge of tread.
7. Handrails may project a maximum of 4-1/2" into stairway.