


UNDERGROUND SERVICE REQUIREMENTS

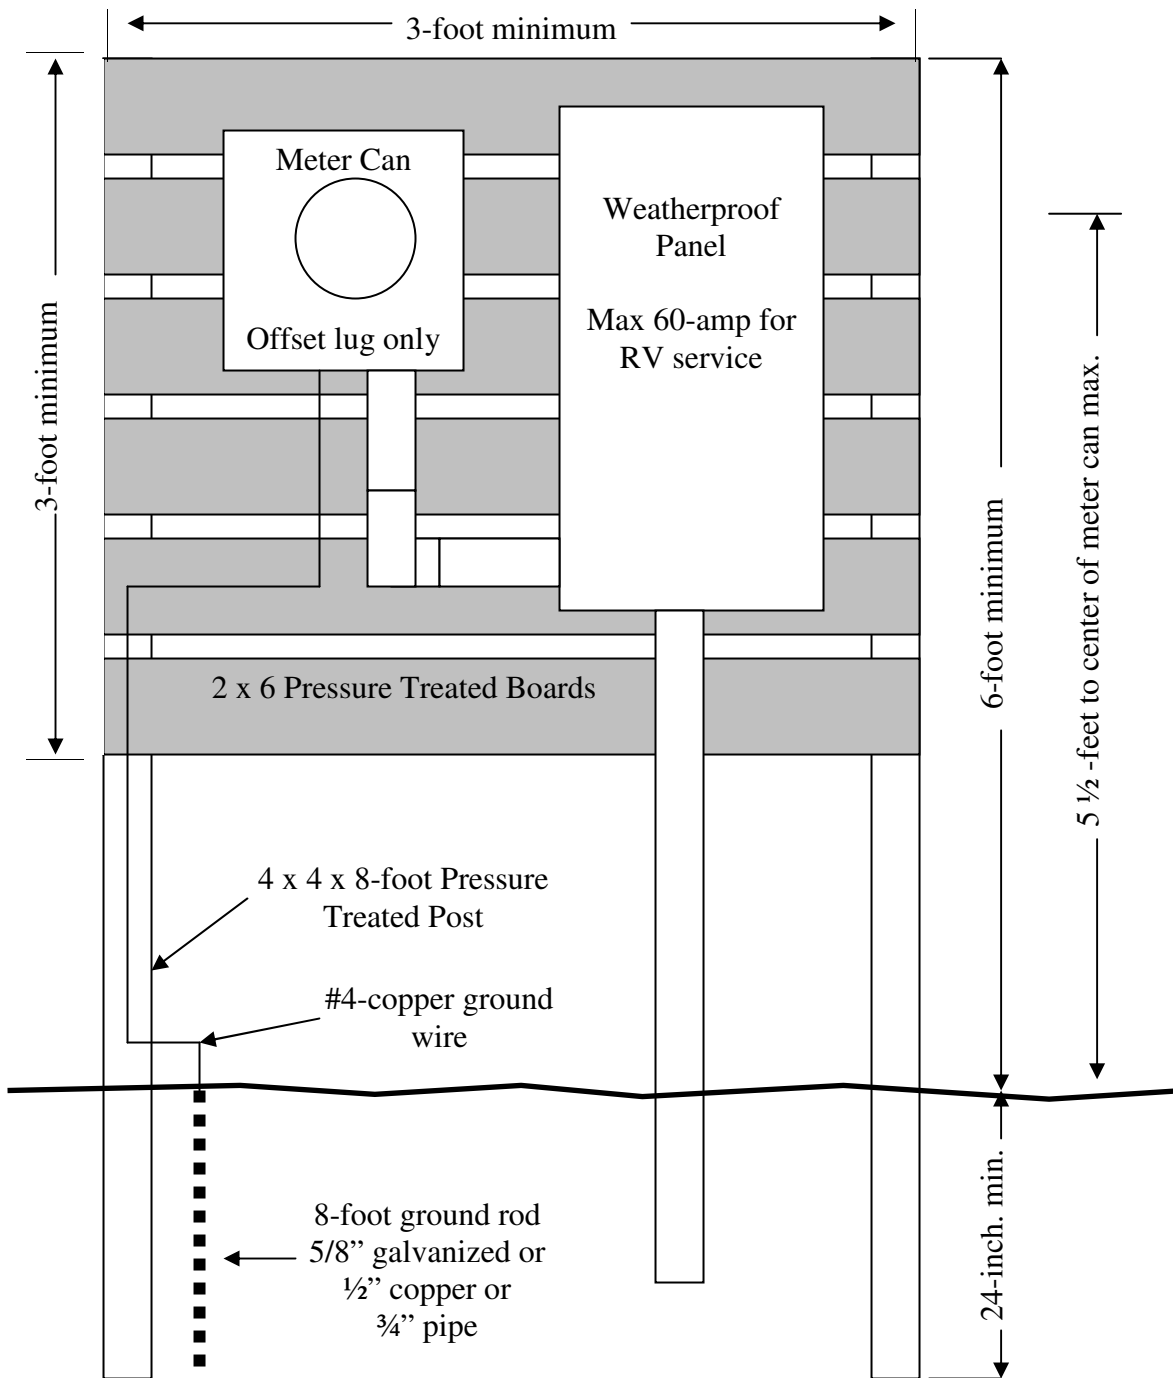

NOTES

1. Maximum meter height of 6-feet to top.
2. Use offset lug meter can only (may be purchased from tri-county electric).
3. Service for R.V. must have a 60-amp main & RV / GFCI receptacle installed for inspection.
4. Burial depths for customer owned wiring are: 18" for PVC & 24" for direct burial wire.
5. Leave ground rod/clamp connection exposed for inspection.
6. Meter/panel combo cans may be mounted on a single 6" x 6" post, buried 3-feet with center of meter at 5 1/2-feet.